
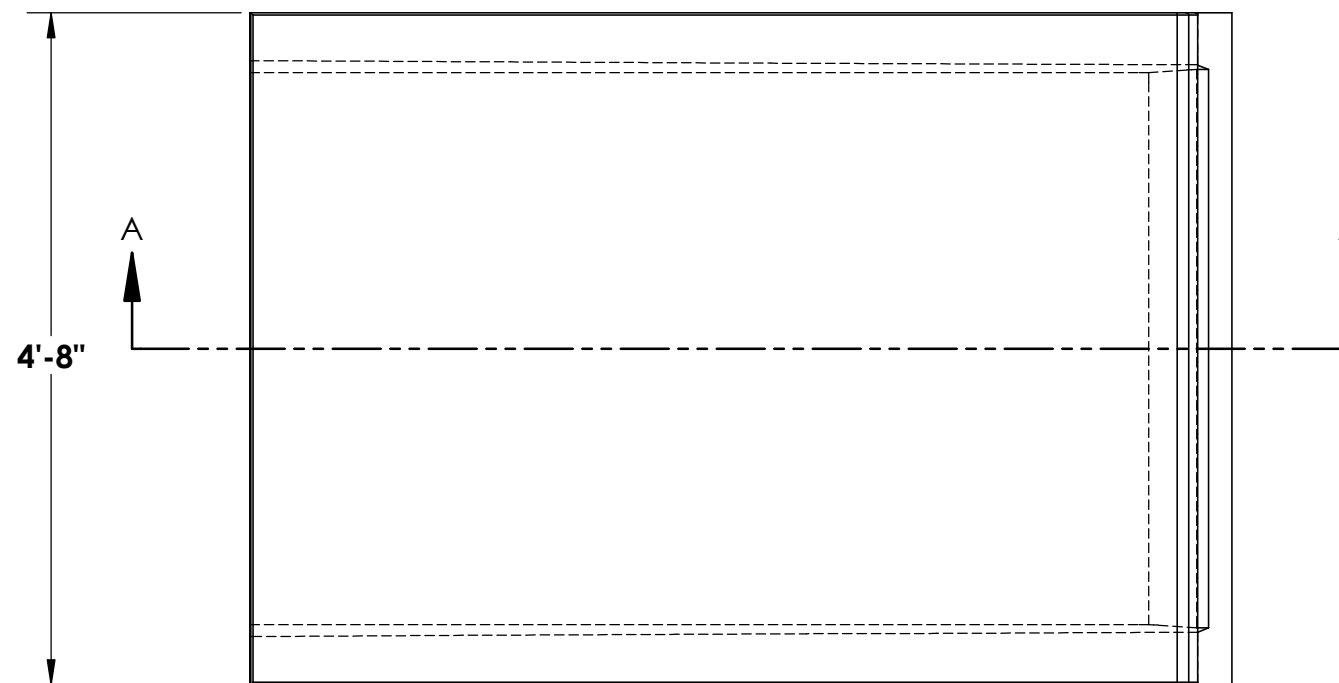


TYPE 2 - SPECIAL CURB INLET

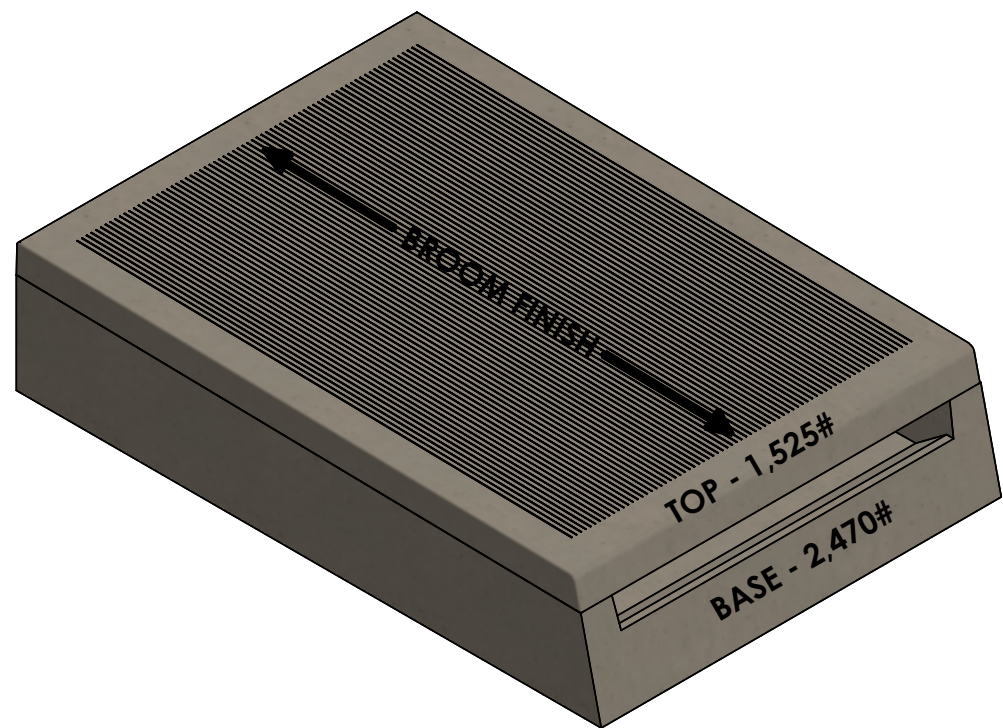


CONCRETE:
4,000 PSI MIN. @ 28 DAYS

REINFORCEMENT:
TOP #4 BAR @ 10" O.C.E.W.
BOTTOM #4 BAR @ 10" O.C.E.W.

NOTES:
ALL EXTERNAL EDGES NOT LABELED
SHALL BE TROWELED WITH 1/4"
RADIUS EDGER

SIZES:
CAN VARY UPON REQUEST

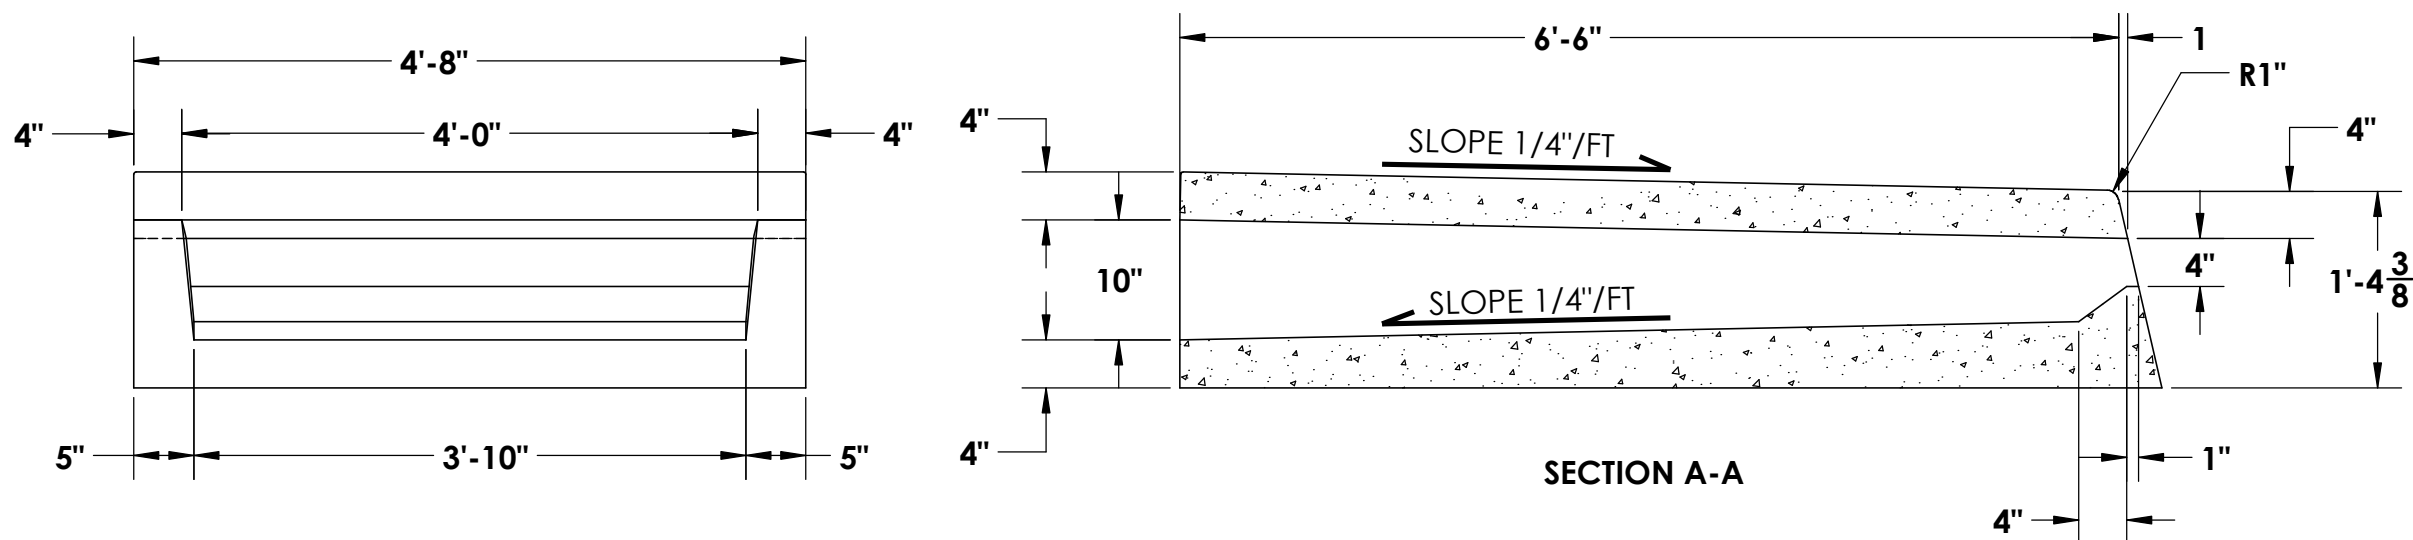

© INLAND NORTHWEST PRECAST



INLAND NORTHWEST PRECAST

5516 NORTH STARR RD PO BOX 610, NEWMAN LAKE, WA 99025 (509) 226-5050



INLETS MEET OR EXCEED SPOKANE COUNTY STANDARD B-9 AND IS CONSTRUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF ASTM C478 (AASHTO M 199), & ASTM C890